


Sampling: 192000 Hz  
FFT size: 65536  
Averaging: 20  
Window: Blackman

7kHz 24.5Vp-p 6.5Om 520mA


Edited by: SpectraPLUS - FFT Spectral Analysis System

Licensed to: Anatoly  
Thu Nov 13 23:34:43 2008

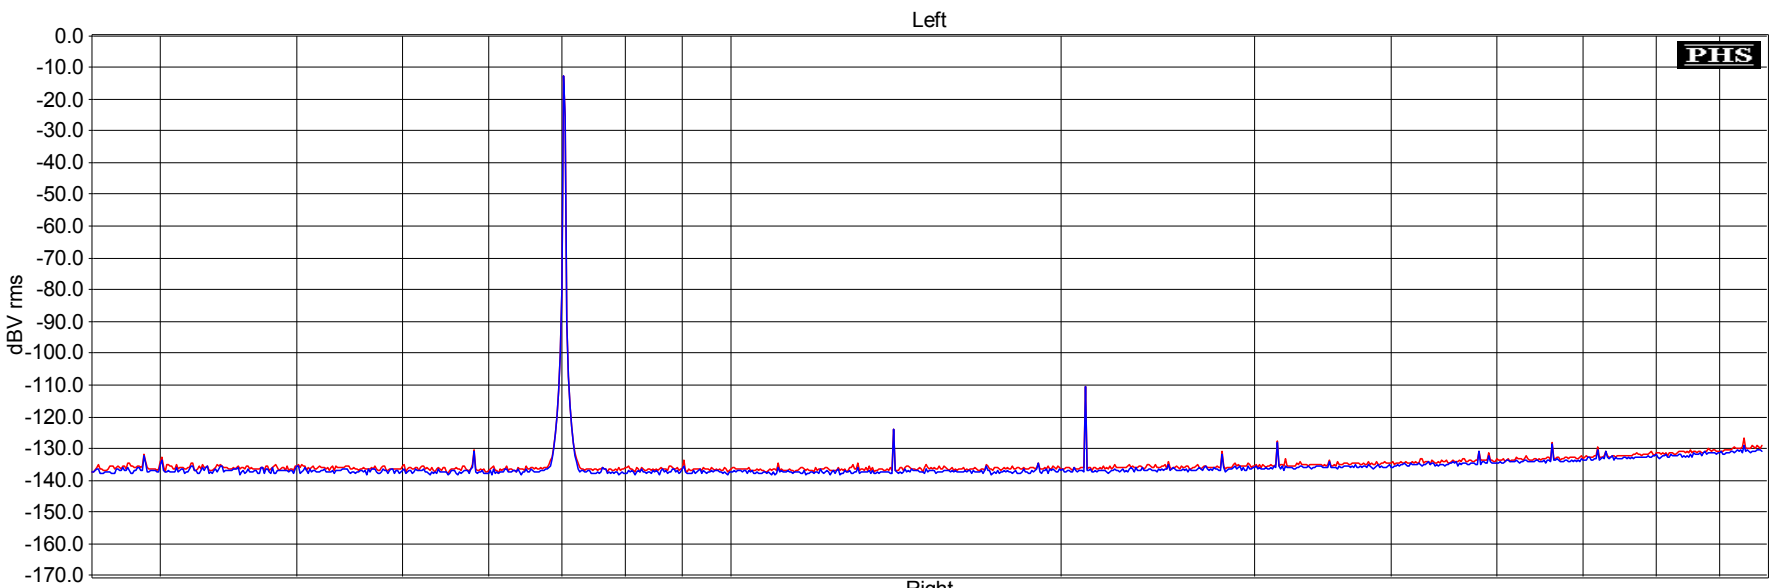

0.0  
-10.0  
-20.0  
-30.0  
-40.0  
-50.0  
-60.0  
-70.0  
-80.0  
-90.0  
-100.0  
-110.0  
-120.0  
-130.0  
-140.0  
-150.0  
-160.0  
-170.0

THD: 0.00138 %  
THD+N: 0.00163 %  
Peak: -12.337 dBV rms

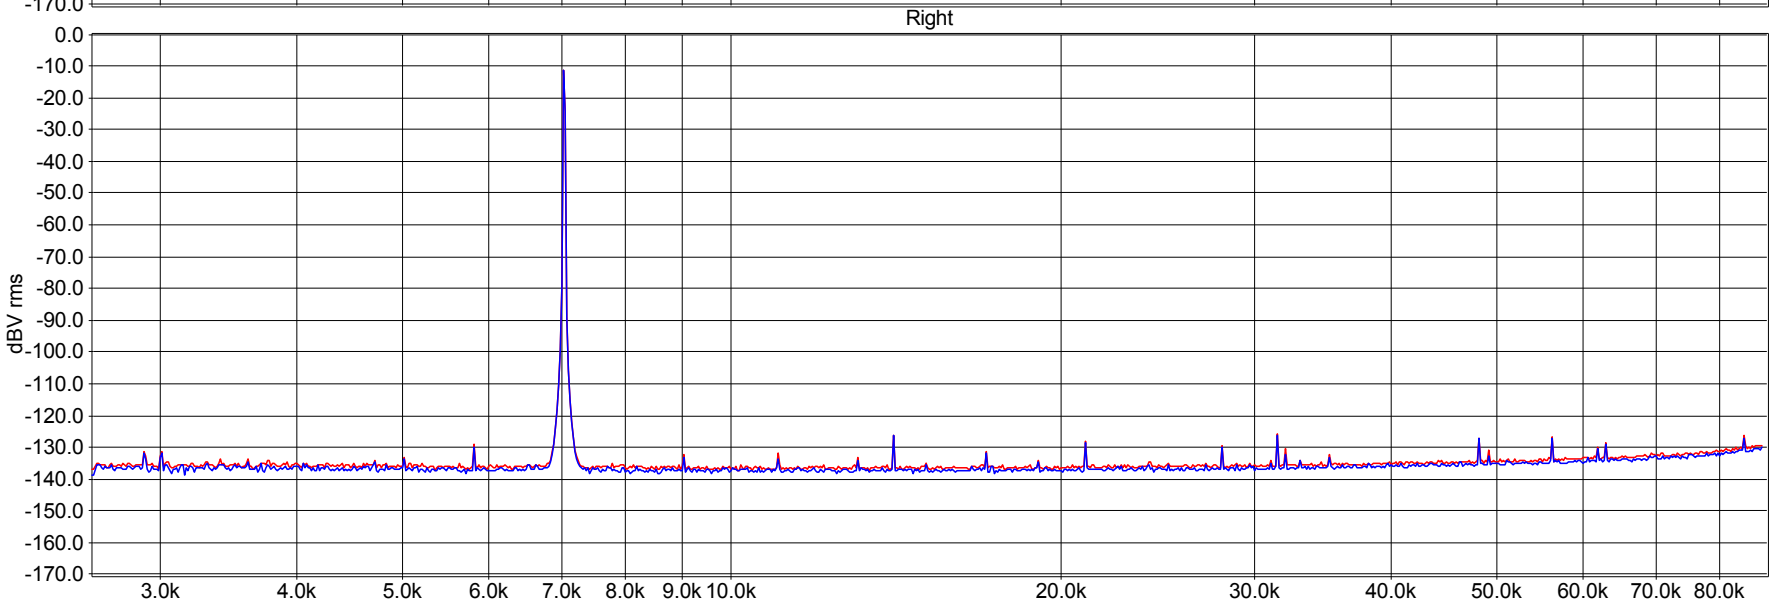

0.0  
-10.0  
-20.0  
-30.0  
-40.0  
-50.0  
-60.0  
-70.0  
-80.0  
-90.0  
-100.0  
-110.0  
-120.0  
-130.0  
-140.0  
-150.0  
-160.0  
-170.0

THD: 0.00042 %  
THD+N: 0.00098 %  
Peak: -11.055 dBV rms

Frequency (Hz)